



## Certified Product Listing

**For:**

Drinking Water System Components - Health Effects

**Company:**

Crispin Valve  
600 Fowler Avenue  
P.O.Box 427  
Berwick, PA 18603, United States

**Plant Location:**

Berwick, PA, USA

**Standards:**

NSF/ANSI 61 Section 8 - 2016  
NSF/ANSI 372 - 2016

**Certificate:**

Issued: 08/28/2017

**Material/Product:**

Air Release Valve

**Contact Temperature:**

23 ± 2°C

**Models:**

AL10  
AL101  
AL102  
AL121  
AL122  
AL141  
AL142  
AL161  
AL162  
AL181  
AL182  
AL20  
AL201  
AL202  
AL241  
AL242  
AL30  
AL31  
AL32  
AL40  
AL41  
AL42  
AL5  
AL61  
AL62  
AL81




Product certified to NSF/ANSI 372 conforms to the requirements for "Lead Free" plumbing products as defined by California, Vermont, Maryland and Louisiana state laws and by section 1417 of the US SDWA.



# TRUESDAIL LABORATORIES, INC.

3337 MICHELSON DRIVE, SUITE CN 750, IRVINE, CA 92612

AL82  
M10  
M3  
M5  
M8  
PL10  
PL10A  
PL20  
UL10  
UL20  
UL30  
UL31  
UL32  
UL40  
UL41  
UL42

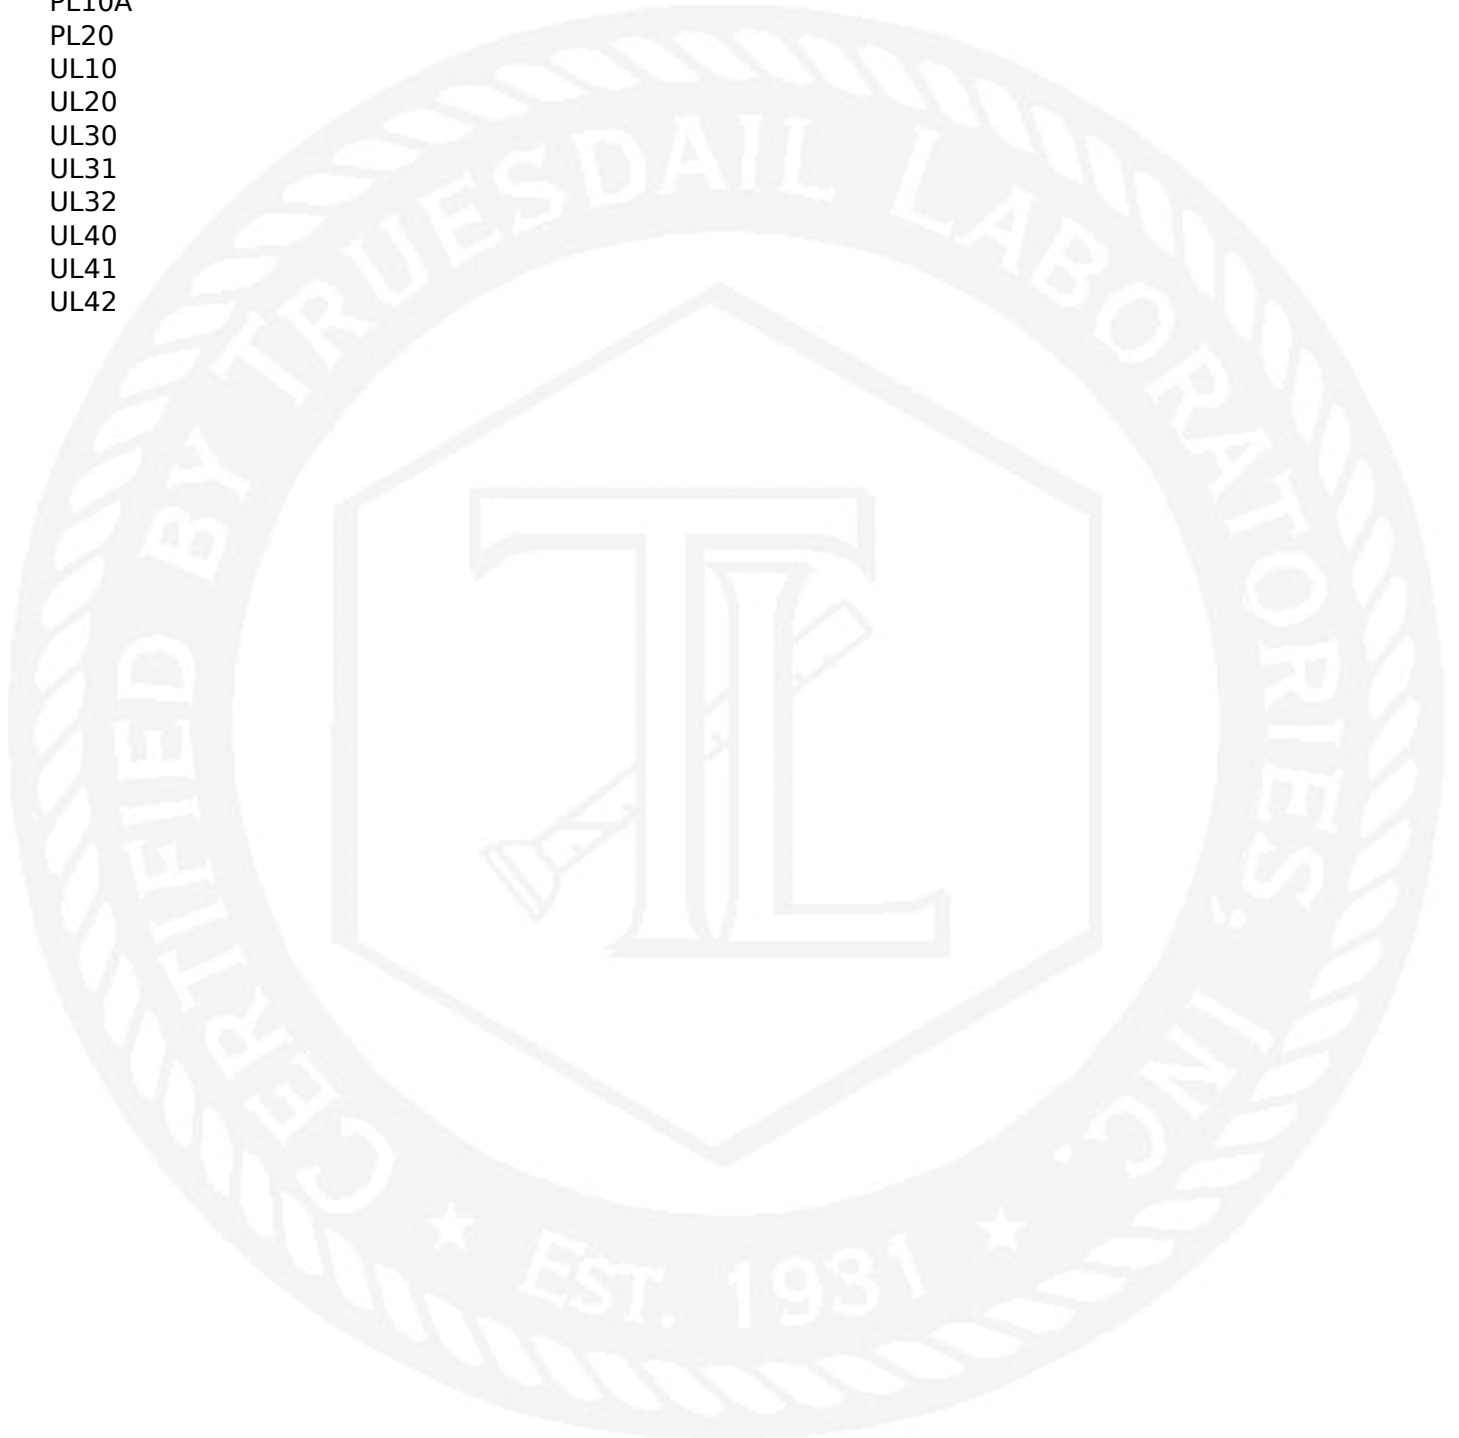

Product certified to NSF/ANSI 372 conforms to the requirements for "Lead Free" plumbing products as defined by California, Vermont, Maryland and Louisiana state laws and by section 1417 of the US SDWA.

Truesdail's Product Certification Listing directory contains the most current certified product(s) and supersedes all printed copies of the listings.